

**CITY OF BALTIMORE WET WEATHER CONSENT DECREE
SMOKE AND DYED WATER TESTING FORM**

Page 1 of 7

Sewershed: JONES FALLS

Company: REI/DRAYCO

Date: 06/19/08

Test to be Performed: SMOKE

Ground Condition: DRY


Supervisor: ER

Manhole ID: S39OO_025MH

Test ID: 0994-358

Notifications
Made: X
(Residents, Fire, 311)

Field Sketch: (Show All Manholes with Numbers, Blower Placement Location, Sandbag or Isolation Locations, Street Names, Building Addresses and Locations, Defect Locations and Photograph Numbers)

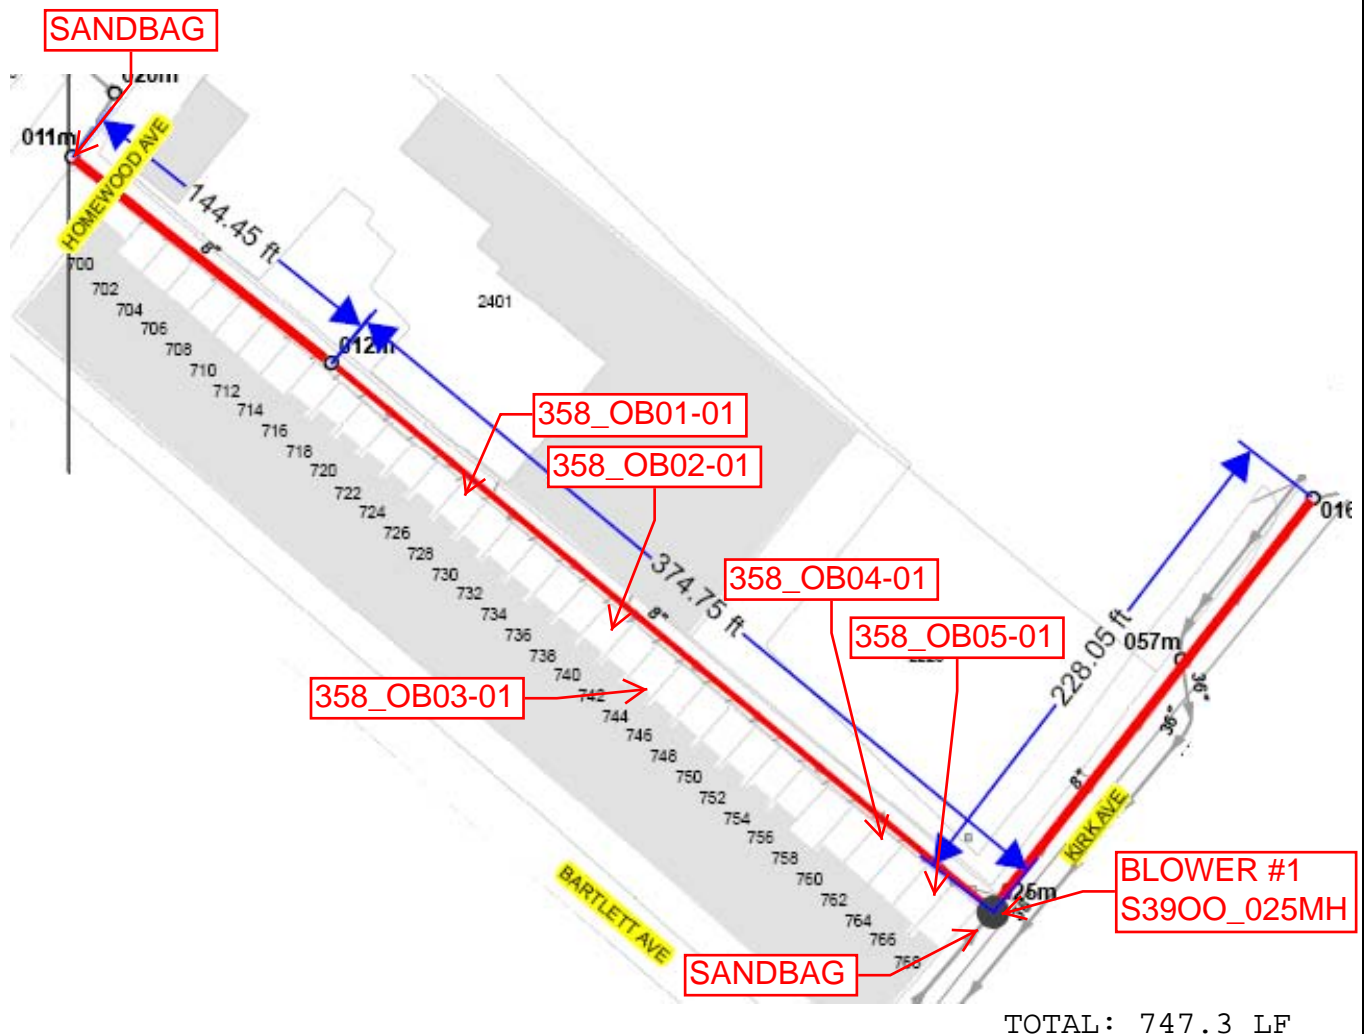

[illegible]

CITY OF BALTIMORE
SMOKE TESTING OBSERVATION SUMMARY
JONES FALLS SEWERSHED
BALTIMORE CITY PROJECT 994
REI/DRAYCO

Unique Test ID: 358	Date: 06/19/2008	Basin: JF-19
Defect No: 1	Supervisor: E.R.	Dye Test Recommended: N
House No: 728	Street Name: BARTLETT	Street Type: AVE
Source Type: 03	Location: 08	Severity: 03
Sector: 02	Drainage Area: 0	
Comments: CLEAN OUT - ABOVE GRADE - MISSING CAP		

SMOKE TEST PHOTOGRAPHS



Photograph No: OB01-01
Filename: 0994-358_OB01-01.jpg

CITY OF BALTIMORE
SMOKE TESTING OBSERVATION SUMMARY
JONES FALLS SEWERSHED
BALTIMORE CITY PROJECT 994
REI/DRAYCO

Unique Test ID: 358	Date: 06/19/2008	Basin: JF-19
Defect No: 2	Supervisor: E.R.	Dye Test Recommended: N
House No: 740	Street Name: BARTLETT	Street Type: AVE
Source Type: 03	Location: 01	Severity: 03
Sector: 02	Drainage Area: 0	
Comments: CLEAN OUT - ABOVE GRADE - MISSING CAP		

SMOKE TEST PHOTOGRAPHS



Photograph No: OB02-01
Filename: 0994-358_OB02-01.jpg

CITY OF BALTIMORE
SMOKE TESTING OBSERVATION SUMMARY
JONES FALLS SEWERSHED
BALTIMORE CITY PROJECT 994
REI/DRAYCO

Unique Test ID: 358	Date: 06/19/2008	Basin: JF-19
Defect No: 3	Supervisor: E.R.	Dye Test Recommended: N
House No: 744	Street Name: BARTLETT	Street Type: AVE
Source Type: 02	Location: 01	Severity: 03
Sector: 02	Drainage Area: 0	
Comments: SMOKE EMINATING FROM CRACK IN GROUND		

SMOKE TEST PHOTOGRAPHS



Photograph No: OB03-01
Filename: 0994-358_OB03-01.jpg

CITY OF BALTIMORE
SMOKE TESTING OBSERVATION SUMMARY
JONES FALLS SEWERSHED
BALTIMORE CITY PROJECT 994
REI/DRAYCO

Unique Test ID: 358	Date: 06/19/2008	Basin: JF-19
Defect No: 4	Supervisor: E.R.	Dye Test Recommended: N
House No: 762	Street Name: BARTLETT	Street Type: AVE
Source Type: 03	Location: 04	Severity: 03
Sector: 02	Drainage Area: 0	
Comments: CLEAN OUT - ABOVE GROUND - ON CURB		

SMOKE TEST PHOTOGRAPHS



Photograph No: OB04-01
Filename: 0994-358_OB04-01.jpg

**CITY OF BALTIMORE
SMOKE TESTING OBSERVATION SUMMARY
JONES FALLS SEWERSHED
BALTIMORE CITY PROJECT 994
REI/DRAYCO**

Unique Test ID: 358	Date: 06/19/2008	Basin: JF-19
Defect No: 5	Supervisor: E.R.	Dye Test Recommended: N
House No: 766	Street Name: BARTLETT	Street Type: AVE
Source Type: 03	Location: 01	Severity: 01
Sector: 02	Drainage Area: 0	
Comments: CLEAN OUT - ABOVE GROUND - NO CAP		

SMOKE TEST PHOTOGRAPHS



Photograph No: OB05-01
Filename: 0994-358_OB05-01.jpg